



NOTE:
ANY LOAD CONNECTIONS TO LOAD 1
BRANCH CIRCUITS MUST HAVE ITS
CORRESPONDING NEUTRAL WIRE
CONNECTED TO THE LOAD 1 NEUTRAL
BUS. ALL LOAD 2 BRANCH
CIRCUITS MUST HAVE ITS
CORRESPONDING NEUTRAL WIRE TO THE
LOAD 2 NEUTRAL BUS.


120/240 GENERATOR:

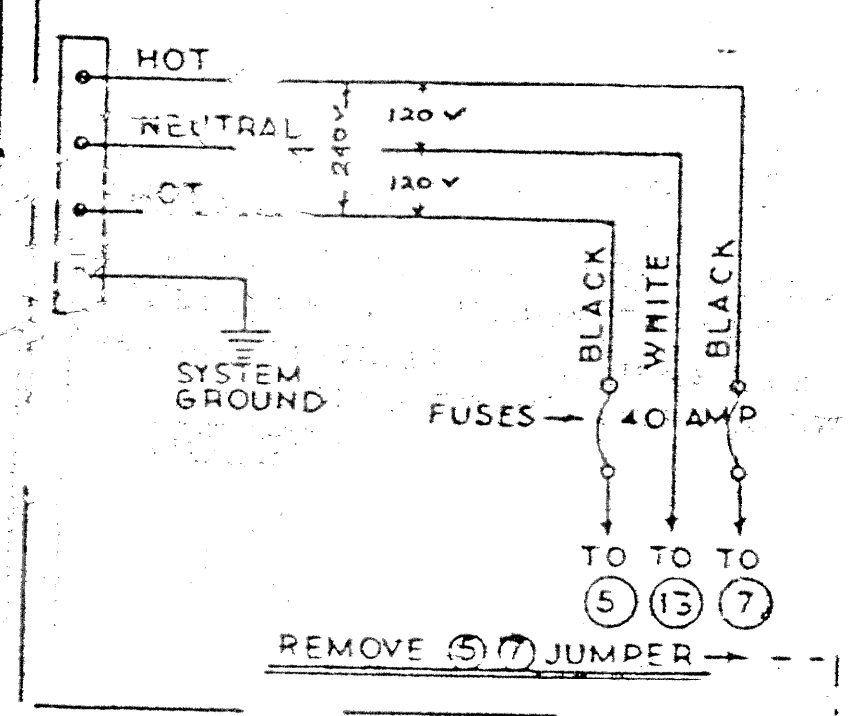

SOURCE SELECTOR SWITCH

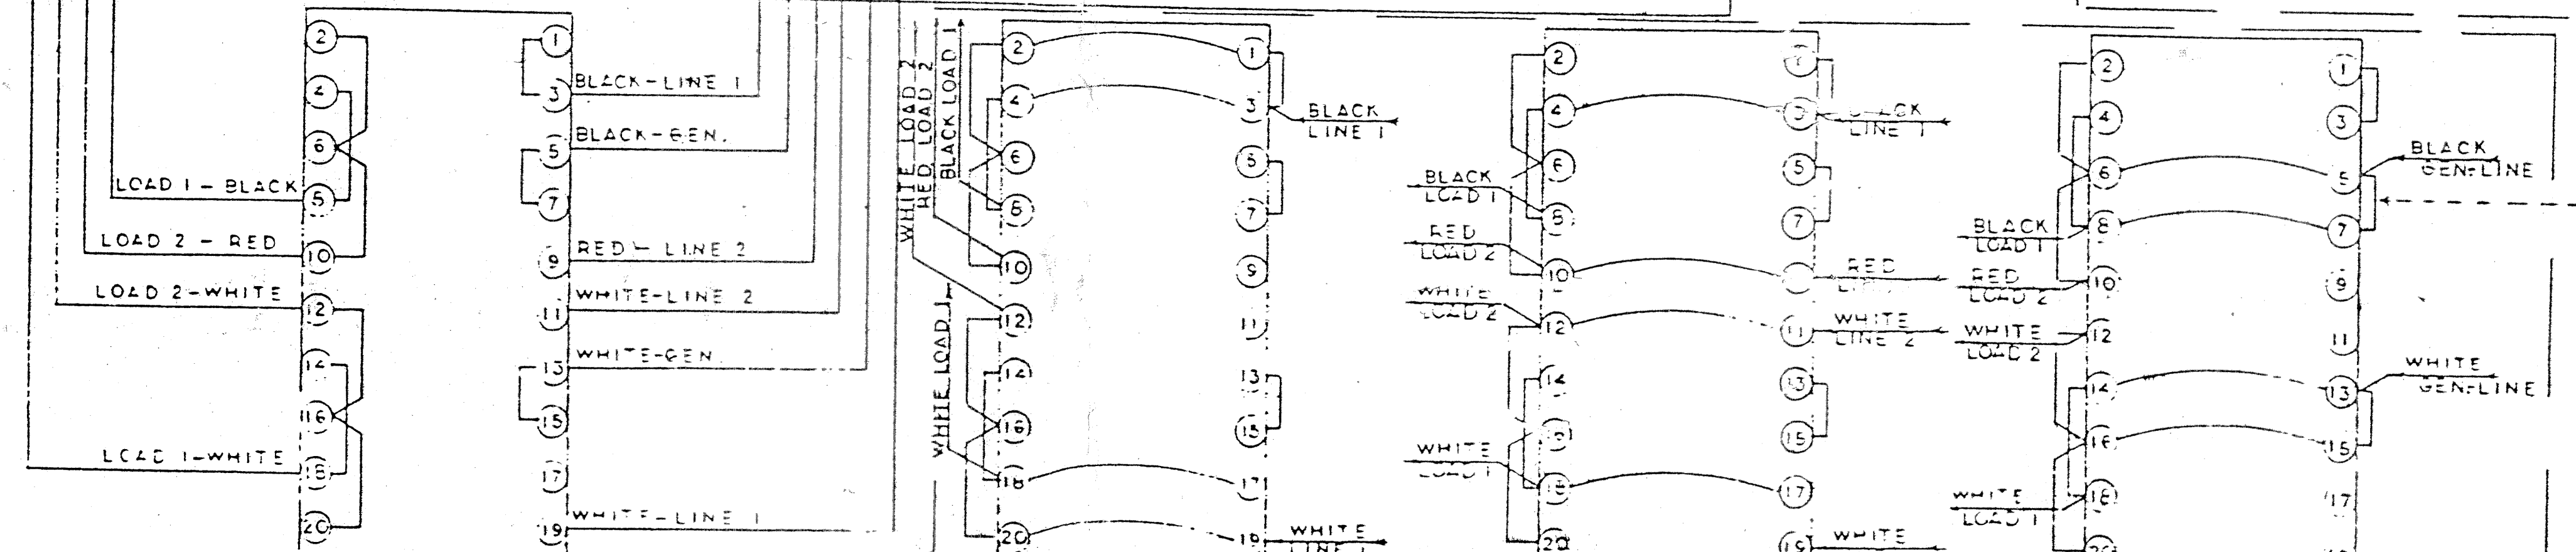

SWITCH POSITIONS

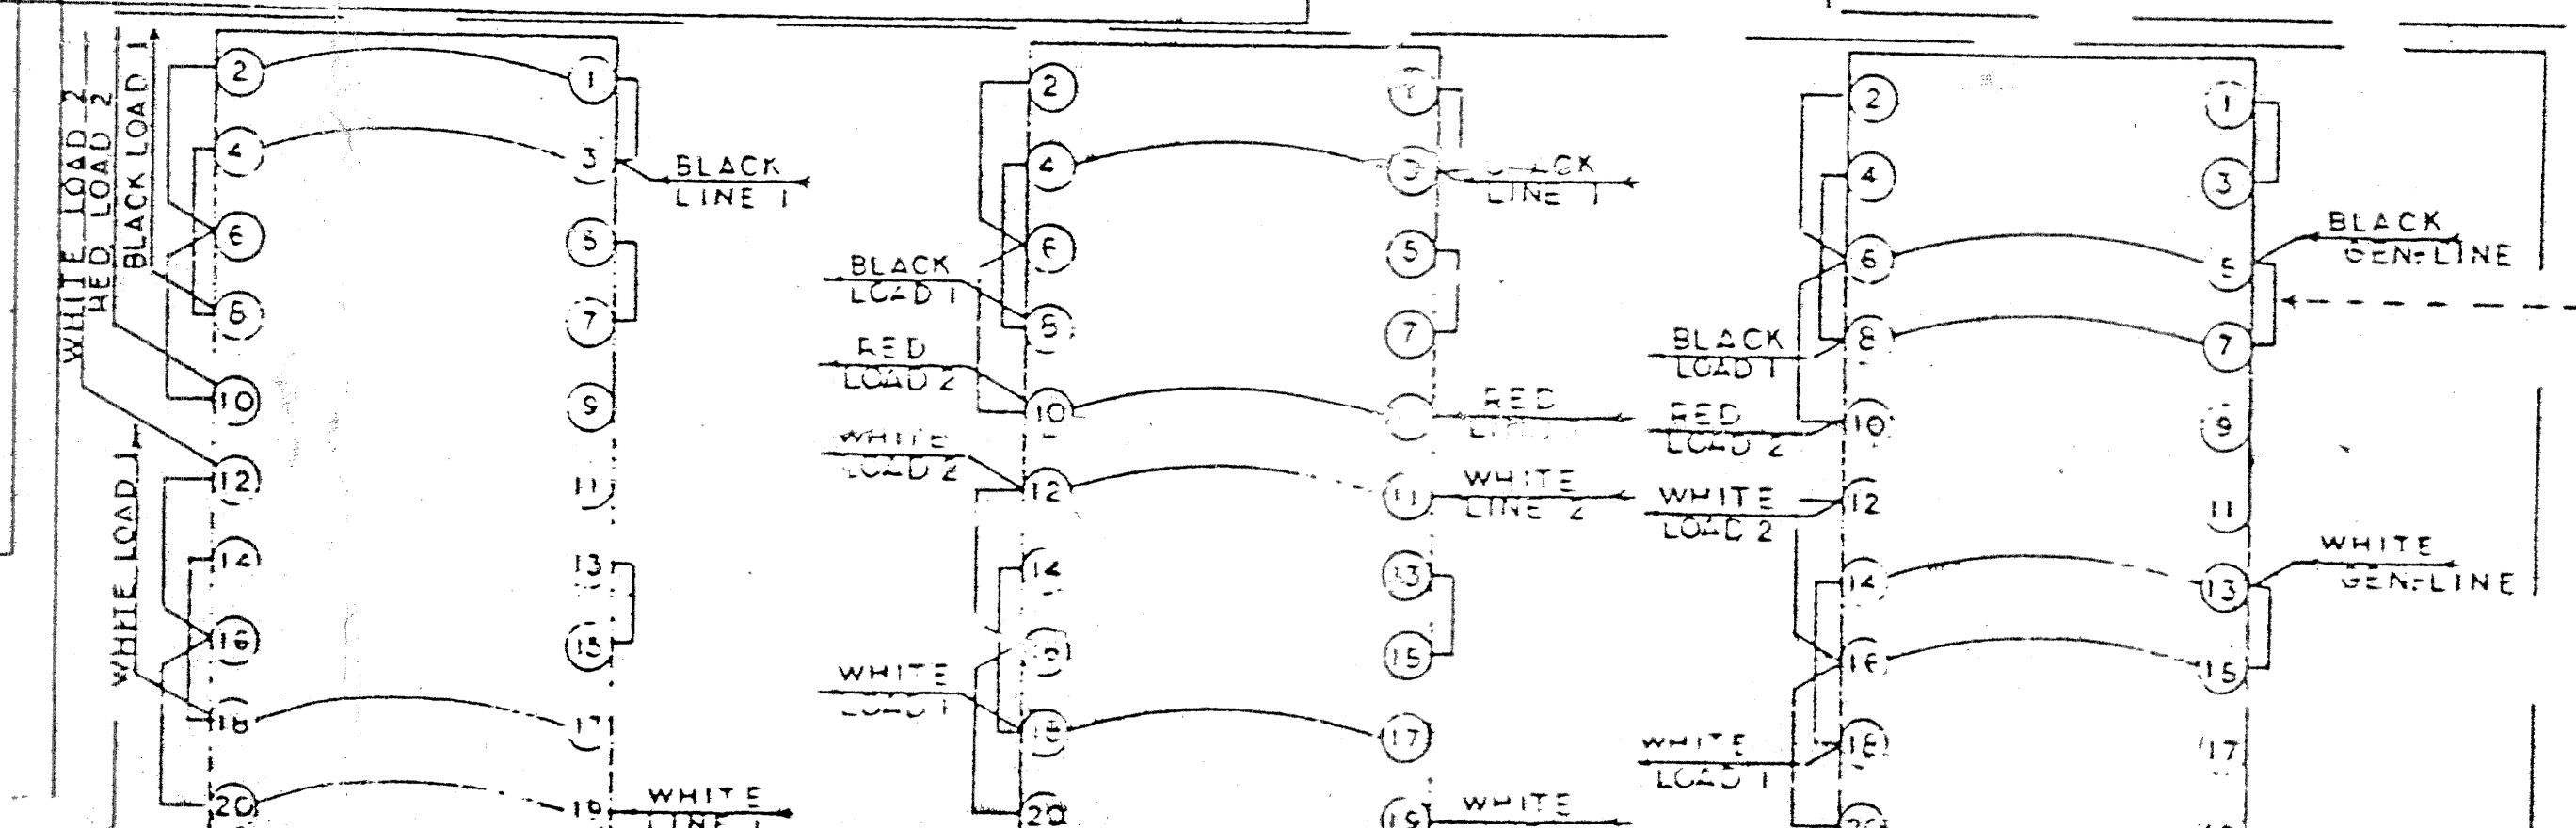

SILVERTON MARINE CORP.		
A.C. ELECTRICAL SYSTEM SCHEMATIC		
60 AMP-120 VOLT SERVICE-W/GENERATOR		
DWN: H. Wilson	CHKD:	DATE: 5-4-64
SCALE: NONE		DWG # E-0410